

# #170 MZP Hospital Phone Paging System



General Layout [08/14/01]

## Application

Page Station panel  
(Customizable)  
One per station





Contact Closures from the phone system to Comet O I/O devices for the triggering of pages from each phone station.


One Comet PS is required for every 12 ReO devices.

**Comet PS**  
12VAC  
2Amp

18 gauge pair

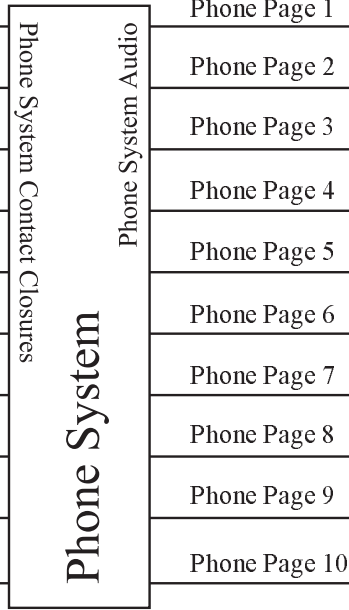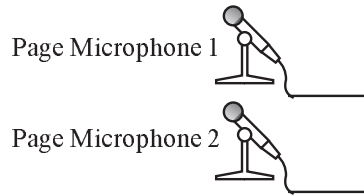


BGM Source

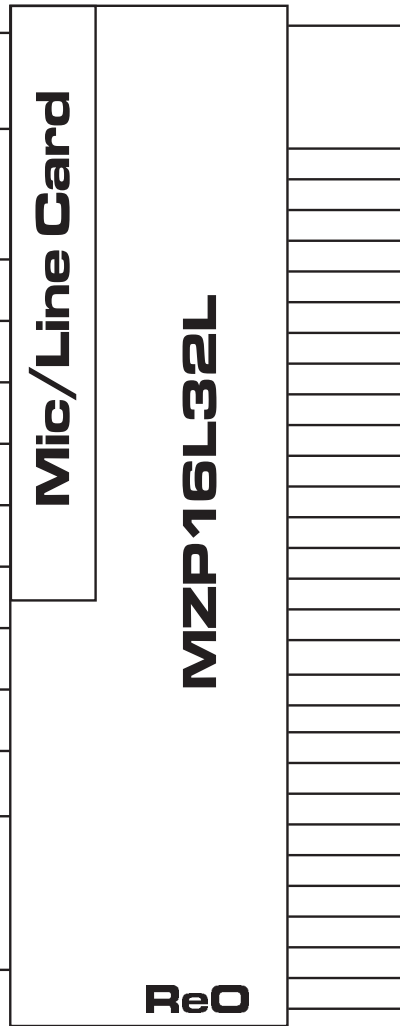

All 30 outputs will be the same as the example shown, as far as volume controls. Each Volume control station will require two comet tail ReO remotes, one for page volume and one for the BGM source.

Volume Control Stations



Cat5 Data Cable

18 gauge pair

**Comet PS**  
12VAC  
2Amp